

# XM670K 5.4

## Controllers for Multiplexed Cabinets

### 1 Introduction

#### 1.1 General Warnings

Please read the following safety precautions and warnings before using this manual:

#### CAUTION

- This manual is part of the product and should be kept near the device for easy and quick reference.
- The device should not be used for purposes different from those described in this manual. It cannot be used as a safety device.
- Check the application limits before proceeding.
- Copeland reserves the right to change the composition of its products, even without notice, ensuring the same and unchanged functionality.

#### CAUTION

##### **SAFETY PRECAUTIONS!**

- Check that the supply voltage is correct before connecting the device.
- Do not expose to water or moisture: use the controller only within the operating limits and avoid sudden temperature changes with high atmospheric humidity to prevent condensation from forming.
- Warning: Disconnect all electrical connections before performing any kind of maintenance.
- Fit the probe where it is not accessible by the end user. The device must not be opened.
- In case of failure or faulty operation, send the device back to the distributor or to Copeland with a detailed description of the fault.
- Verify the maximum current that can be applied to each relay (see Section 16, Technical Data).
- Ensure that the wires for probes, loads, and the power supply are separated and far enough from each other without crossing or intertwining.
- In case of applications in industrial environments, the use of main filters in parallel with inductive loads could be useful.

## 2 Before Proceeding

### 2.1 Software Release of XM670K

1. Look at the software release of XM670K printed on the label of the controller.

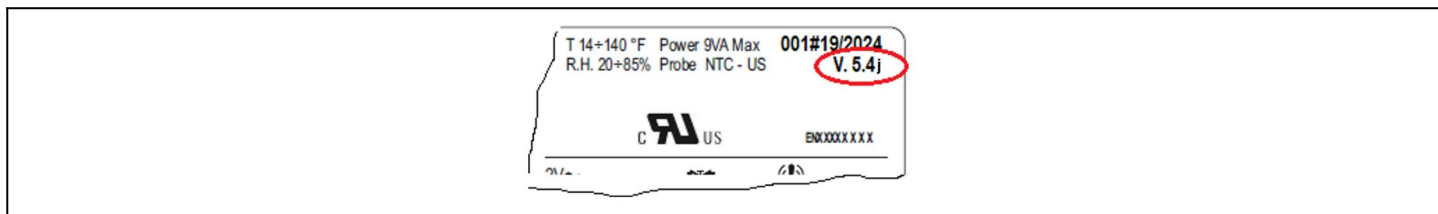


Figure 2-1 - Software Release of XM670K 5.4

2. If the software release is 5.4, proceed with this manual; otherwise contact Copeland to access the correct manual.
3. Note that RTC is not supported on devices connected to E2, E3, and Site Supervisor.
4. For the latest XM600 release notes, click [here](#).

## 3 General Description

The **XM670K** is a high level microprocessor based controllers for multiplexed cabinets suitable for applications on medium or low temperature. It can be inserted in a LAN of up to 8 different sections which can operate, depending on the programming, as stand alone controllers or following the commands coming from the other sections. The XM670K has respectively 4 and 6 relay outputs to control the solenoid valve, defrost - which can be either electrical or hot gas - the evaporator fans, the lights, an auxiliary output (XM670K) and an alarm output (XM670K). The XM670K also has four probe inputs, one for temperature control, one to control the defrost end temperature of the evaporator, the third for the display and the fourth can be used for application with virtual probe or for inlet/outlet air temperature measurement. Finally, the XM670K is equipped with three digital inputs (free contact) fully configurable by parameters.

The instruments are equipped with the HOT KEY connector that permits to be programmed in a simple way. Direct serial output **RS485 ModBUS-RTU** compatible permits a simple XWEB interfacing. The HOT KEY connector can be used to connect **X-REP** display (depending on the model).

### 3.1 Ordering Codes

Table 3-1 - Product Ordering Codes

Part Number	Description
318-6521	XM670K Case Controller Solenoid, 110V, V5.4, NTC CPC, with Connectors
318-6750	Remote Display Keyboard CX660 for XMs
318-6751	Remote Display Keyboard CH660 for XMs
318-6752	Hot Key Program Key 512K

## 4 Installation and Mounting

This device can operate without any user interface, but normal application is with CX660 or CH660 keyboard (both 660 displays are supported).

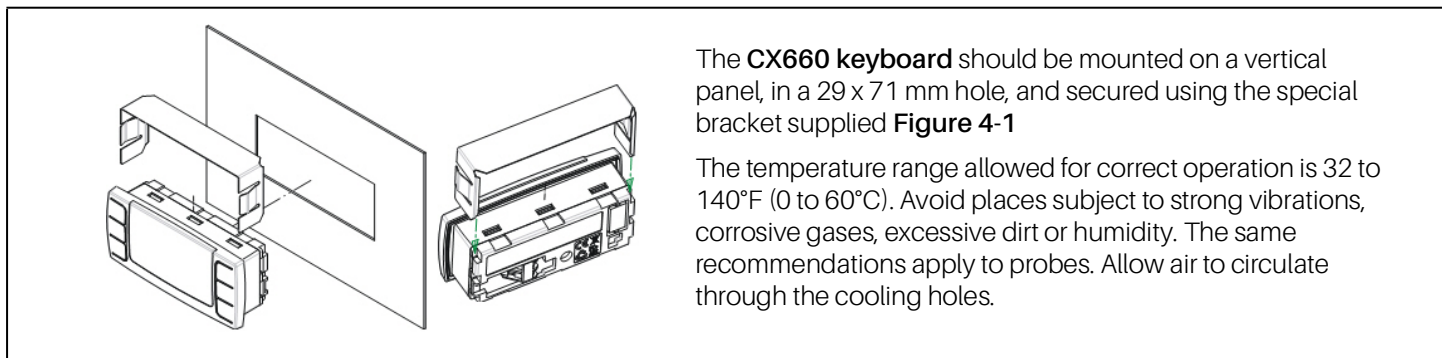


Figure 4-1 - CX660 Keyboard Installation and Mounting

### 4.1 Dimensions

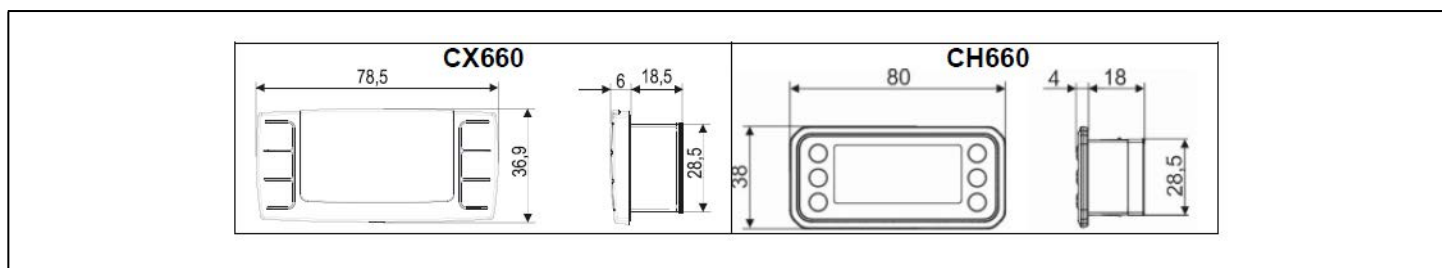


Figure 4-2 - CX660 and CH660 Dimensions

## 5 Wiring Diagram and Connections

### 5.1 Important Note

The **XM** device is provided with a disconnectable terminal block to connect cables with a cross-section of up to 1.6 mm<sup>2</sup> for all low voltage connections: RS485, LAN, probes, digital inputs, and keyboard. Other inputs, power supply and relay connections are provided with a screw terminal block or Faston connection (5.0 mm). Heat-resistant cables have to be used. Before connecting the cables, verify that the power supply complies with the controller's requirements. Separate the probe cables from the power supply cables, outputs and power connections. Do not exceed the maximum current allowed on each relay. In case of heavier loads, use a suitable external relay. ***N.B Maximum current allowed for all loads is 16A.***

The probes should be mounted with the bulb upwards to prevent damages due to casual liquid infiltration. It is recommended to place the thermostat probe away from air streams to measure the average room temperature correctly. Place the defrost termination probe among the evaporator fans in the coldest place (where most ice is formed) and far from heaters or from the warmest place during defrost to prevent premature defrost termination.

### 5.2 XM670K- All Power Supply

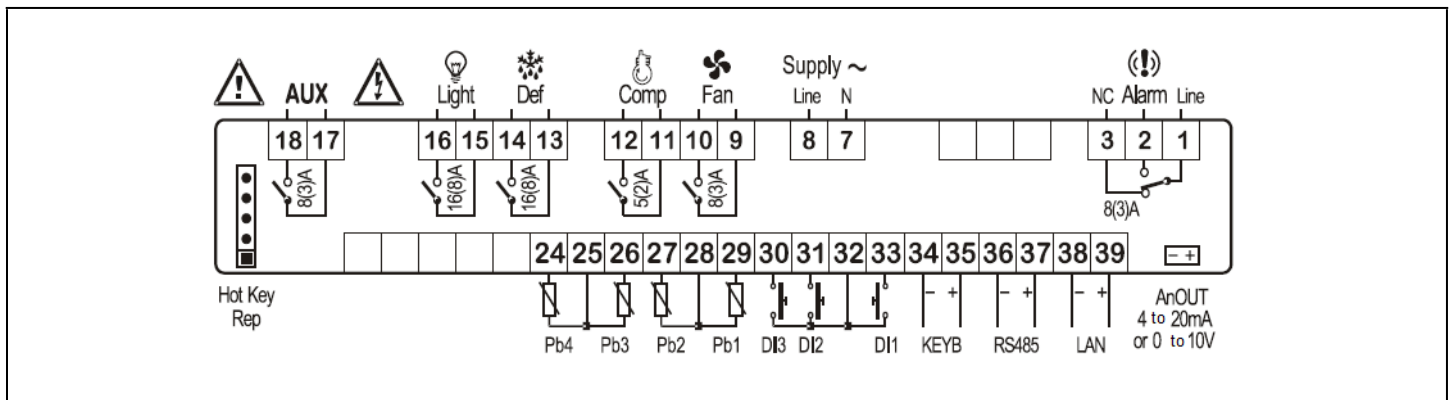


Figure 5-1 - Wiring and Connections

Models with 115V supply: use terminals 8-7 for supply.

### 5.3 Keyboard Display CX660 or CH660

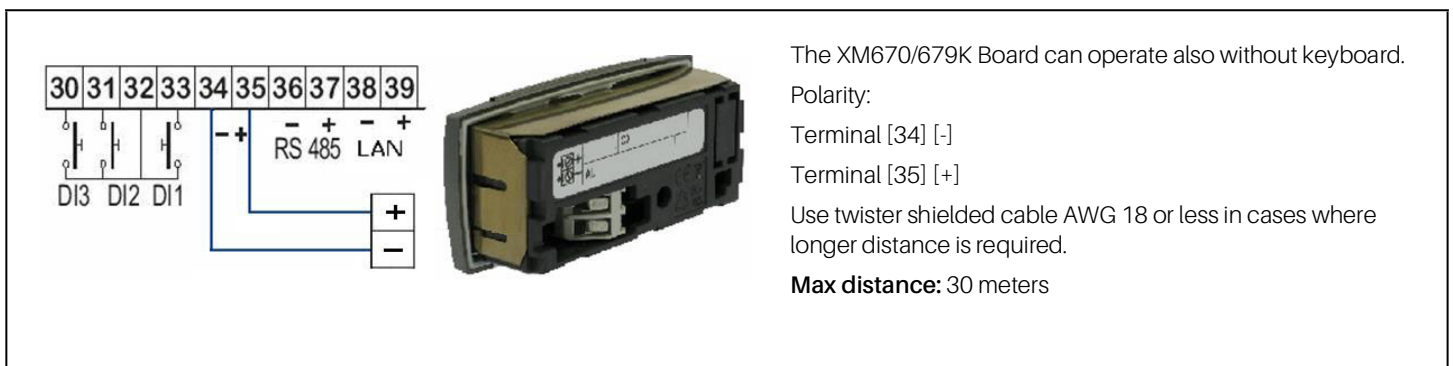


Figure 5-2 - Keyboard Display

## 5.4 LAN Connection - Maximum of 8 Connections

To create a LAN connection and to perform synchronized defrost (also called master-slave functioning):

1. Connect a shielded cable between terminals **38 [-]** and **39 [+]** for a **maximum of eight (8) sections**.
2. The **Adr** parameter is the number that identifies each electronic board. **Address duplication is not permitted**; in this case, synchronized defrost and the communication with the monitoring system are not guaranteed (the **Adr** is also the MODBUS address). See **Figure 5-3** for an example of a properly configured LAN connection:

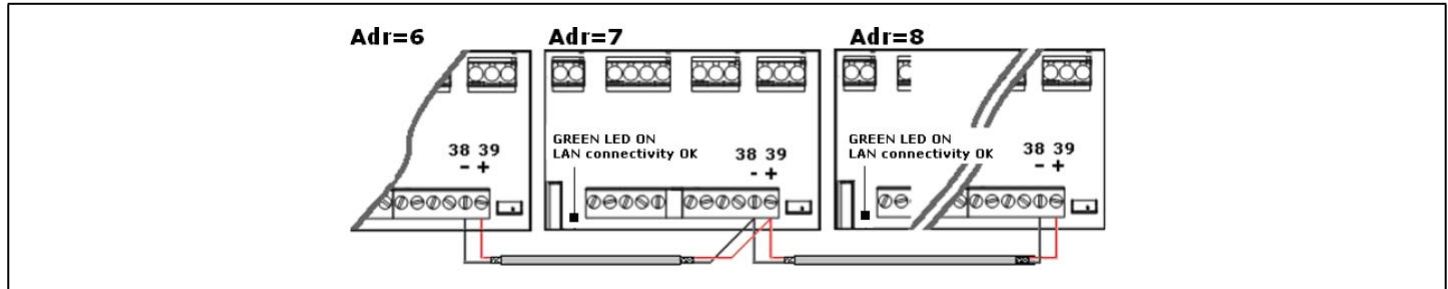


Figure 5-3 - LAN Connection

### NOTE

If the LAN is connected properly, the green LED will be ON. If the LAN is not connected properly, a blinking LED will display.  
The maximum allowed distance is 30 meters.

## 5.5 How to Connect the Monitoring System

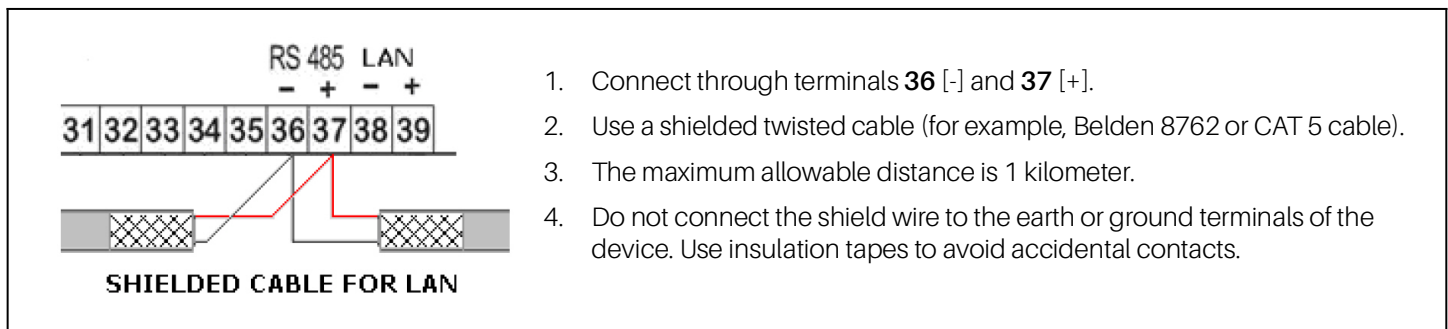


Figure 5-4 - Connecting the Monitoring System

Only one controller for each LAN should be connected to the RS485 connection.


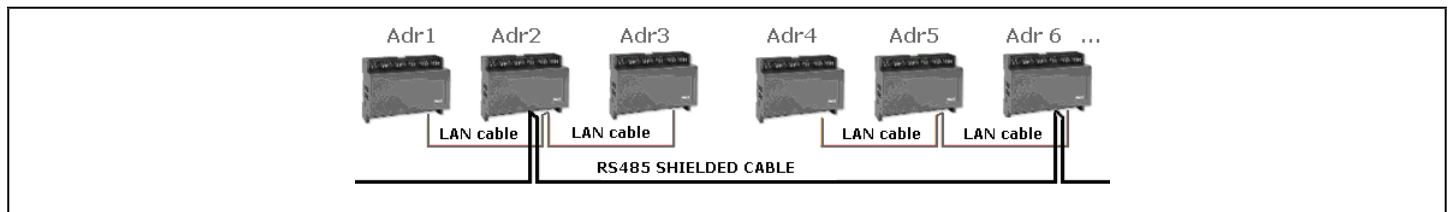


Figure 5-5 - Connecting Monitoring Systems

The **Adr** parameter is the number that identifies each electronic board. **Address duplication is not permitted**; in this case, synchronized defrost and the communication with the monitoring system are not guaranteed (the **Adr** is also the MODBUS address).

## 5.6 Digital Inputs



1. Terminals [30] through [33] are all free of voltage.
2. Use a shielded cable for distances higher than one meter.

For each digital input, configure the parameters: **i1P** (polarity of activation), **i1F** (function of the input), and **i1d** (delay of signaling).

Figure 5-6 - Digital Inputs


The **i1P** can be set to: **cL**= active when closed; or **oP**= active when opened.

The **i1F** parameter can be set to: **EAL** = external alarm, **Bal** = serious lock alarm, **PAL**= pressure switch alarm, **dor** = door switch, **dE F**= external defrost, **AUS**= auxiliary activation command, **LiG**= light activation, **OnF** = board On/OFF, **FHU**= do not use this configuration, **ES**= day/night, or **HdY** = do not use this configuration.

The **i1d** parameter is for the delay of activation.

For the other digital inputs, same set of parameters is present: **i2P**, **i2F**, **i2d**, **i3P**, **i3F**, **i3d**.

## 5.7 Analog Output



- Can be set between 4 to 20mA and 0 to 10VDC.
- Use a CABCJ15 cable for connections.

Figure 5-7 - Analog Output

The analog output is located near the terminal [39] on a two-pin connector. The analog output can be used to control anti-sweat heaters using a chopped phased controller, XRPW500 (500 watt) or family, XV...D or XV...K.

6 User Interface

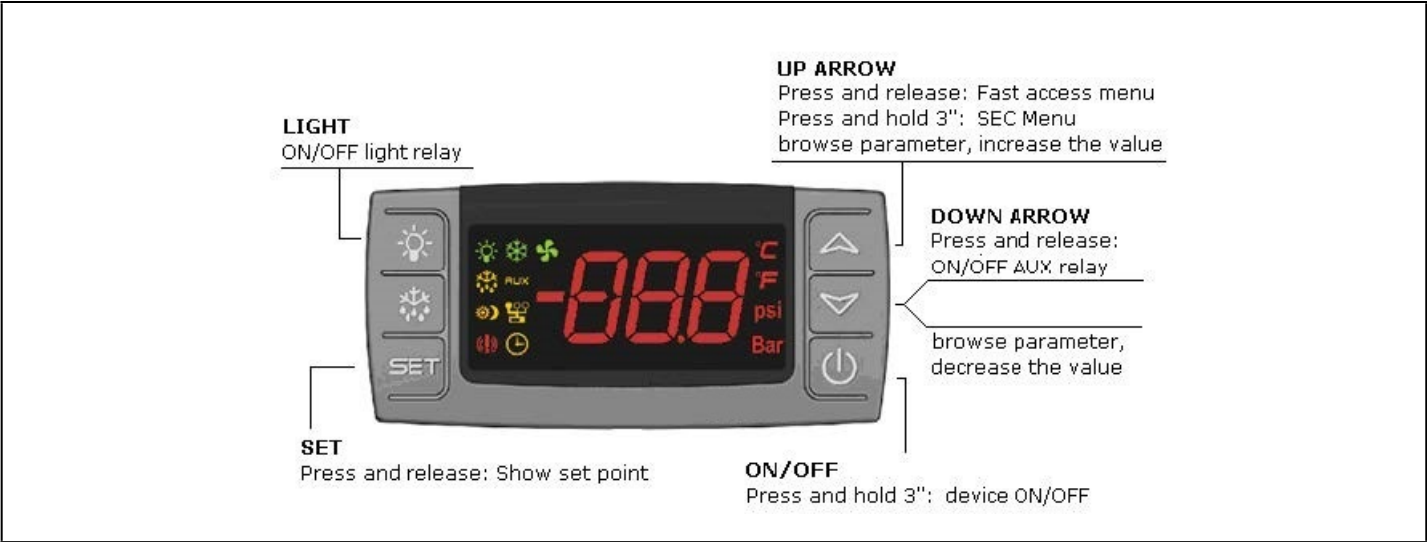










Figure 6-1 - XM670K Display

6.1 Icons

Table 6-1- XM670K Display Icons

Cooling Output					<p>The output is activated when the icon is ON. A delay is present when the icon is blinking.</p> <p>MEASUREMENT UNIT</p> <p>°C, Bar, and ⌚ (time) are ON depending on the selection.</p>
Light				Fan	
Defrost		AUX	Auxiliary relay		
Energy Saving			Multimaster enabled		
Generic alarm			Clock/time		
DURING PROGRAMMING: The measurement units of temperature and pressure will blink.					




6.2 Keyboard Commands

Single commands:

- **LIGHT relay**: Press the light button
- **AUX relay**: Press the down arrow button
- **Manual defrost**: Press the defrost button for three (3) seconds
- **ON/OFF**: Press the **ON/OFF** button for three (3) seconds (if the function is enabled)
- **Energy Saving**: Press the **ON/OFF** button for three (3) seconds (if the function is enabled)

6.2.1 Double Commands





Table 6-2 - Keyboard Double Commands

	Press for three (3) seconds to lock (Pon) or unlock (PoF) the keyboard.
	Press both keys to exit the programming mode or from a menu; when on submenus <b>EEV</b> , pressing these keys returns you to the previous level.
	Press both keys for three (3) seconds to enter the first level of the programming mode.

6.3 How to Modify the Air Temperature Regulation Setpoint

The thermostat setpoint is the value used to regulate air temperature. The regulation output is controlled by the electronic valve or the relay.

Table 6-3 - Modifying the Air Temperature Regulation Setpoint







BEGIN		Press the <b>SET</b> key for three (3) seconds (the measurement units will blink).
Value modification	 or 	Use the up arrow and down arrow keys to change the LS and US parameters value.
EXIT		Press the <b>SET</b> key to save the value (the value will blink for two (2) seconds).

In any case, it is possible to wait for about 10 seconds to exit. In order to show the air temperature set is sufficient to press and release the SET button, the value is displayed for approximately 60 seconds for **KEY COMBINATIONS**.

## 7 How to Program the Parameters (Pr1 and Pr2)

The device has two programming levels: **Pr1** (direct access) and **Pr2** (password-protected, access for higher level users).

Table 7-1 - Programming the Parameters (Pr1 and Pr2)

ACCESS to Pr1	SET+ 	Press for three (3) seconds to enter the first programming level (Pr1).
Select item	 or 	Press the up arrow or down arrow key to select the parameter or submenu.
Show value	SET	Press the SET button.
Modify	 or 	Press the up arrow or down arrow key to change the value.
Confirm and store	SET	Press SET (the value will blink for three (3) seconds and then display the next parameter).
EXIT	SET + 	Press to exit the programming mode, or wait for 10 seconds to exit.

### 7.1 How to Enter Pr2

To enter **Pr2** programming menu:

1. Press **SET+ down arrow** keys for three (3) seconds to enter **Pr1** menu (the first label will display).
2. Press **down arrow** until the **Pr2** label displays and then press **SET**.
3. A blinking "PAS" label displays. Wait a few seconds.
4. When a blinking "0 - -" displays, enter the password [**321**] by pressing the up arrow and down arrow keys. Press **SET** to save.

**GENERAL STRUCTURE:** The first two items, rtC and EEV, are related to the submenus of the other parameters.

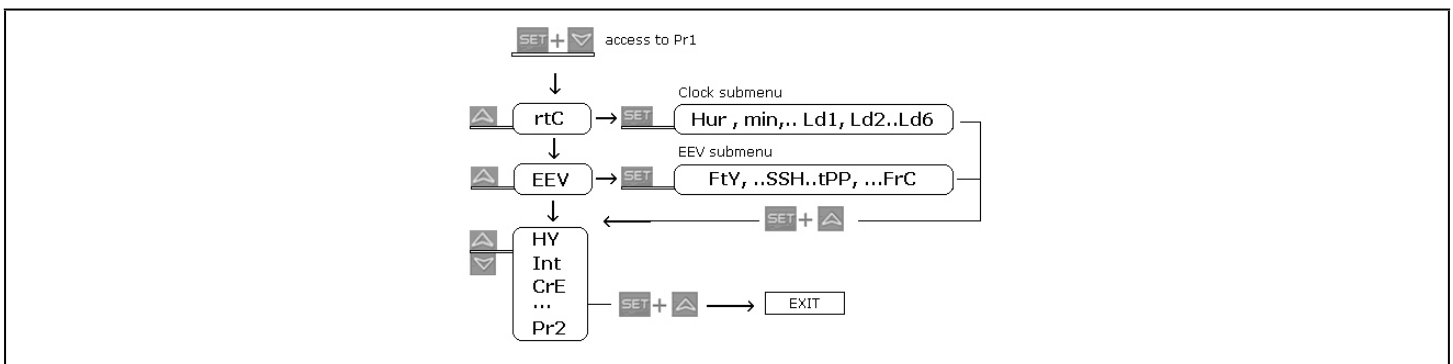


Figure 7-1 - General Structure

- Pressing the **SET + up arrow** keys on the rtC or EEV submenu returns you to the parameter list.
- Pressing the **SET + up arrow** keys on the parameter list exits the screen.





### 7.2 How to Move a Parameter From Pr1 to Pr2 Level and Vice Versa

Enter the Pr2 level and select the desired parameter then press the **SET+ down arrow** keys. If the LED on the left-hand side of the screen is ON, it means that the parameter is present in Pr1 level; if the LED is OFF, it means that the parameter is not present in Pr1 (Only Pr2).


## 8 Fast Access Menu

The Fast Access menu contains the list of probes and values that are automatically emptied by the board such as the superheat and percentage of valve opening. The values: nP or noP stand for probe not present or value not emptied, and Err means the value is out of range, the probe is damaged, not connected, or configured incorrectly.

Table 8-1 - Fast Access Menu

ENTERING THE FAST ACCESS MENU		Press and release the up arrow key. The duration of the menu in case of inactivity is about 3 minutes. Depending on the configuration of the board, the values display.
<p>To select an entry, press the  or , then press <b>SET</b> to view the value or to move to the next value.</p>	<p><b>MAP</b> Current map (0 to 3): it shows which map is used</p> <p><b>HM</b> Access to clock menu or reset the RTC alarm</p> <p><b>An</b> Value of analog output</p> <p><b>SH</b> Value of superheat. nA = not Available</p> <p><b>oPP</b> Percentage of valve opening</p> <p><b>dP1</b> (Pb1) Value read by probe 1</p> <p><b>dP2</b> (Pb2) Value read by probe 2</p> <p><b>dP3</b> (Pb3) Value read by probe 3</p> <p><b>dp4</b> (Pb4) Value read by probe 4</p> <p><b>dP5</b> (Pb5) Temperature read by probe 5 or value obtained from pressure transducer</p> <p><b>dP6</b> (Pb6) Value read by probe 6</p> <p><b>dPP</b> Pressure value read by (Pb5) transducer</p> <p><b>rPP</b> Virtual pressure probe, only on slave</p> <p><b>rPP</b> Virtual pressure probe, only on slave.</p> <p><b>rCP</b> Value of P4 remote probe for heaters. It is displayed only with P4C = LAn. If the value is not available "noP" label is displayed.</p> <p><b>dPr</b> Virtual probe for room temperature regulation [rPA and rPb]</p> <p><b>rSE</b> Real thermoregulation setpoint: the value includes the sum of SET, HES and/or the dynamic setpoint if the functions are enabled.</p> <p><b>L*t</b> Minimum room temperature</p> <p><b>H*t</b> Maximum room temperature</p> <p><b>tMd</b> Time to next defrost (minutes)</p> <p><b>LSn</b> Number of devices in the LAN</p> <p><b>LAn</b> Address list of devices in the LAN</p> <p><b>GAL</b> To see all the active alarms in each device connected to the LAN</p>	
EXIT	<b>SET</b> + 	Press together or wait the time out for 60 seconds.

## 9 Multimaster Function Menu (SEC)

The function “section” SEC is enabled when the  icon is lit. It allows entering the remote programming mode from a keyboard not physically connected to the board through the LAN functionality.

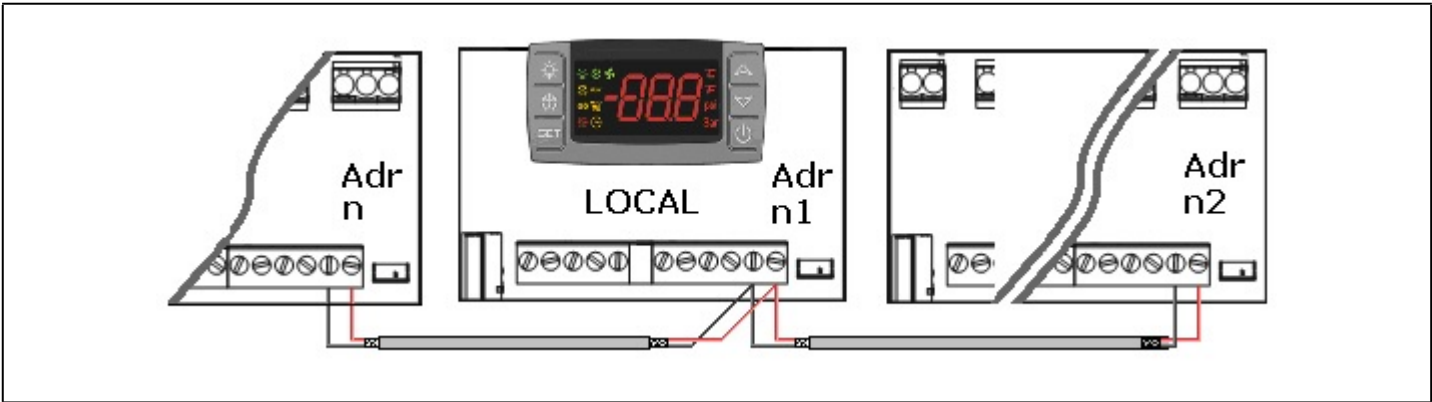







Figure 9-1 - LAN Connection


Table 9-1 - Multimaster Function Menu Action Buttons


Action	Button or display		Notes
Enter menu			Press the up arrow key for about three (3) seconds; the  icon will be ON.
Waiting for action	SEC		The menu to change the section will be entered. <b>SEC</b> label will be displayed.
Enter section list	<b>SET</b>		Press <b>SET</b> to confirm. The following list will be available to select the proper network function.
Select proper function	 or 	LOC GLb	To gain access only to the local device. To share global command to all the devices connected to the LAN.
Confirm	<b>SET</b>		Select and confirm an entry by pressing <b>SET</b> button.
Exit menu	<b>SET</b> + 		Press <b>SET</b> and the up arrow together or wait approximately 10 seconds.

(\*) The devices on the LAN are indexed by using the Adr parameter (in ascending order).

EXAMPLES:


1. To modify the same parameter values in all the devices connected to the LAN: enter the multi-master menu. Select and confirm **ALL**. Exit from the multi-master menu. Enter the programming menu and change the required parameter values. The new values will be changed on all devices connected to the LAN.

 **CAUTION**

At the end of programming, select the LOC section to switch OFF the  icon.






## 9.1 Synchronized Defrost

The synchronized defrost allows multiple defrosts to be managed from different boards connected through the LAN connection. In this way, the boards can perform simultaneous defrosts with the possibility to end them in a synchronized manner.

 **CAUTION**

In this case, the **Adr** parameter cannot be duplicated because defrost cannot be managed correctly.

Table 9-2 - Synchronized Defrost Keys

BEGIN	SET + 	Press for three (3) seconds, the <b>rtC</b> or other will be showed. The measurement unit blinks.
Find Adr		Press the down arrow key several times to find the <b>Adr</b> parameter, then press <b>SET</b> .
Modify Adr	 or 	Set the value of <b>Adr</b> parameter, then press <b>SET</b> to confirm the parameter.
EXIT	SET + 	Press both keys to exit from menu or wait for about 10 seconds.

The **LSn** and **LAn** parameter are used only to show the actual settings (read only). See **Figure 9-2** for an example of configuration:

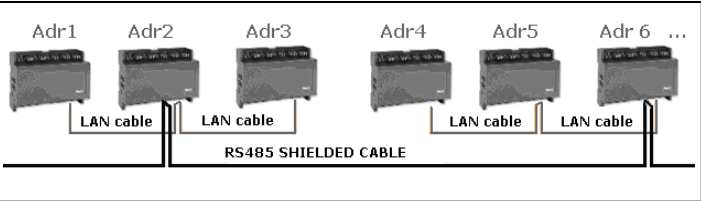



Figure 9-2 - Configuration Example

### 9.1.1 Daily Defrost From RTC: [EdF = rtC]

- **IdF Parameter:** For safety reasons, force the value of **Idf** at + 1 with respect to the interval between the two **Ld** parameters. The **IdF** timer is restarted after defrost and at every power ON.
- **DEFROST START:** At the time selected by the parameters **Ld1** to **Ld6** or **Sd1** to **Sd6**.
- **DEFROST END:** If the probes reach the **dtE** temperature or for maximum **MdF** time.
- **SAFETY and RtC or RtF ALARM:** With clock alarm, the device will use the parameters **IdF**, **dtE** and **MdF**.

 **CAUTION**

DO NOT SET [EdF = rtC] and [CPb = n].

**MULTIMASTER DEFROST:** All the probes with real-time clock function:

Table 9-3 - Multi-master Defrost Example



Parameter	Unit A (RTC)	Unit B (RTC)	Unit C (RTC)
<b>Adr</b>	n	N + 1	N + 2
<b>EdF</b>	rtC (clock)	rtC (clock)	rtC (clock)
<b>IdF</b>	9 hours safety	9 hours safety	9 hours safety
<b>MdF</b>	45 minutes safety	45 minutes safety	45 minutes safety
<b>dtE</b>	12°C safety	12°C safety	12°C safety
<b>Ld1</b>	06:00 1°	06:00 1°	06:00 1°
<b>Ld2</b>	14:00 2°	14:00 2°	14:00 2°
<b>Ld3</b>	22:00 3°	22:00 3°	22:00 3°

## 10 Commissioning

### 10.1 Clock Setting and RTC Alarm Reset

If the clock is present: [EdF = rtC] enable the defrost from rtc [Ld1 to Ld6].

Table 10-1 - Clock Setting and RTC Alarm Reset

BEGIN		Press the up arrow key once to access the fast access menu.
Display	HM identify the clock RTC, press <b>SET</b>	
Display	HUr = hour -> press <b>SET</b> to save or change MIn = minutes -> press <b>SET</b> to save or change Do not use the other parameters if present.	
EXIT	<b>SET</b> + 	Press <b>SET</b> + up arrow keys for 10 seconds to reset the RTC alarm.

NOTE: The rtC clock menu is present also on the second level parameters.



#### CAUTION

If the board displays the rtF alarm, it means that the board has to be replaced.

# 11 Display Messages

Table 11-1 - Display Messages

Display	Causes	Notes
KEYBOARD		
<b>nod</b>	No display: the keyboard is trying to work with another board that is not working or not present	Press for three (3) seconds the up arrow, enter the <b>SEC</b> menu and select <b>LOC</b> entry
<b>Pon</b>	Keyboard is unlocked	
<b>PoF</b>	Keyboard is locked	
<b>rSt</b>	Alarm reset	Alarm output deactivated.
<b>noP, nP nA</b>	Not present (configuration) Not available (evaluation)	
<b>noL</b>	The keyboard is not able to communicate with the XM670K	Verify the connection or call Copeland Technical Service
ALARM FROM PROBE INPUT		
<b>P1 P2 P3 P4 PPF CPF</b>	Sensor brake down, value out of range or sensor incorrectly configured <b>P1C, P2C to P6C</b> .  <b>PPF</b> can be showed by slaves of pressure that do not receive the value of pressure.  <b>CPF</b> is showed when the remote probe 4 is not working.	<b>P1</b> : the cooling output works with <b>Con</b> and <b>COF</b> ,  With defrost probe on error the defrost is performed only at interval.
TEMPERATURE ALARM		
<b>HA</b>	Temperature alarm from parameter <b>ALU</b> on probe <b>rAL</b> .	Outputs unchanged.
<b>LA</b>	Temperature alarm from parameter <b>ALL</b> on probe <b>rAL</b> .	Outputs unchanged.
<b>HA2</b>	Second high temperature alarm.	Outputs depends on setting.
<b>LA1</b>	Second low temperature alarm.	Outputs depends on setting.
DIGITAL INPUT ALARM		
<b>dA</b>	Door open alarm from input <b>i1F, i2F</b> or <b>i3F</b> = after delay <b>d1d, d2d</b> or <b>d3d</b> .	Cooling relay and fan follow the <b>odc</b> parameter. Cooling restart as specified on <b>rrd</b> parameter.
<b>EA</b>	Generic alarm from digital input <b>i1F, i2F, i3F</b> = <b>EAL</b> .	
<b>CA</b>	Severe alarm of regulation lock from digital input <b>i1F, i2F, i3F</b> = <b>bAL</b> .	Regulation output OFF.
<b>PAL</b>	Pressure switch lock <b>i1F, i2F</b> or <b>i3F</b> = <b>PAL</b> .	All the outputs are OFF.

Table 11-1 - Display Messages

Display	Causes	Notes
CLOCK ALARM		
rtC	Clock settings lost.	Defrost will be performed with <b>IdF</b> till restoring the settings of RTC.
rtF	Clock damaged.	Defrost will be performed with <b>IdF</b> .
OTHERS		
EE	EEPROM serious problem.	Output OFF.
Err	Error with upload/download parameters.	Repeat the operation.
End	Parameters have been correctly transferred.	
dEF	Defrost is in progress.	
cLn	Cleaning function is active.	

## 11.1 Alarm Recovery

Probe alarms **P1**, **P2**, **P3**, and **P4** start some seconds after the fault in the related probe; they automatically stop some seconds after the probe restarts normal operation. Check the connections before replacing the probe.

Temperature alarms **HA**, **LA**, **HA2**, and **LA2** automatically stop as soon as the temperature returns to normal values.

Alarms **EA** and **CA** (with **i1F** = **bAL**) recover as soon as the digital input is disabled. Alarm **CA** (with **i1F** = **PAL**) recovers only by switching OFF and ON the device.

## 12 Controlling Loads

### 12.1 Temperature Probe Reference for Regulation

Up to 5 temperature probe can be used for the temperature regulation. It is possible to set the probes used for temperature regulation. Up to 5 Temperature inputs Pb1, Pb2, Pb3, Pb4, Pb6, can be used.

To support above function, the parameters rPA, rPb, rP3, rP4, rP5 are used. Which temperature probe methods of combine is set by par. rPd among the following: Average, Minimum, Maximum, First, or Mix.

**rPd = rPA:** Temperature detected by the probe set in the parameter rPA.

**rPd = rAb:** Mix between rPA and rPb defined by rPE parameter.

**rPd = AUr:** Average temperature of all the probes defined as Regulation Probe in the parameters rPA, rPb, rP3, rP4.

**rPd = LoE:** Minimum value among all the temperature probes defined as Regulation Probe in the parameters rPA, rPb, rP3, rP4.

**rPd = HiE:** Maximum value among all the temperature probes defined as Regulation Probe in the parameters rPA, rPb, rP3, rP4.

#### 12.1.1 Sensor Failure

In case of multiple temperature sensor regulation: (rPd = rAb, Aur, LoE, HiE), and with sensor failure, the remaining sensors are used for the regulation.

In case of all sensor failure, the regulation will be performed according to Con and COF parameters.

### 12.2 Dual Temp Mode Operation

Controller can have up to 4 pre-set regulation.

The preset regulation is set in the parameter MAP.

By digital input or supervising system is possible to enable the second regulation mode, set in the parameter M2P.

In this way a dual temp case can be easily set and controlled.

#### 12.2.1 Second Map Function by Digital Input Configuration

By setting on digital input among i1F, i2F, i3F as the "nt" the map set in the parameter MP1 is loaded when the digital input is enabled.

### 12.3 The Solenoid Valve

The regulation is performed according to the temperature measured by the thermostat probe that can be physical probe or virtual probe obtained by a weighted average between two probes (see parameters table description) with a positive differential from the setpoint. If the temperature increases and reaches setpoint plus differential the solenoid valve is opened and then it is closed when the temperature reaches the setpoint value again.

In case of fault in the thermostat probe the opening and closing time of solenoid valve is configured by "Con" and "CoF" parameters.

### 12.4 Pump Down Before Defrost

The following parameters has been added:

**Pdt** pump down type (nu; Fan; F-C)

With **Pdt = nu**, the pump down is not enabled.

With **Pdt = Fan**, when a defrost trigger is given:

- Compressor relay will be open.
- EEV valve (if present):
  - will be closed with CrE = N, Y
  - will be open with CrE = EUP or EU5
- Fan will be forced on for Pdn time

With **Pdt = F-C**, when a defrost trigger is given:

- EEV valve (if present):
  - will be closed with CrE = N, Y
  - will be open with CrE = EUP or EU5
- Compressor relay and Fan will be forced on for Pdn time

**Pdn** pump down duration (0 to 255 minutes)

### 12.5 Defrost

#### 12.5.1 Defrost Starting

In any case, the device checks the temperature that is read by the configured defrost probe before starting the defrost, after that:

- (If RTC is present) Two defrost modes are available through the **tdF** parameter: defrost with electrical heater and hot gas defrost. The defrost interval is controlled by the parameter **EdF**: (**EdF = rtC**) defrost is made in real time depending on the hours set in the parameters **Ld1** to **Ld6** in workdays and in **Sd1** to **Sd6** on holidays; (**EdF = in**) the defrost is made every **ldF** time.

- Defrost cycle starting can be operated locally (manual activation by means of the keyboard or digital input or end of interval time) or the command can come from the master defrost unit of the LAN. In this case, the controller will operate the defrost cycle following the parameters it has programmed. At the end of the drip time, it will wait until all the other controllers of the LAN finish their defrost cycle before restarting the normal regulation of the temperature according to **dEM** parameter.
- Each time any of the LAN controller begins a defrost cycle, it issues the command into the network making all the other controllers start their own cycle. This allows a perfect synchronization of the defrost in the whole multiplexed cabinet according to the **LMd** parameter.
- Selecting the dPA and dPb probes and by changing the **dtP** and **ddP** parameters, the defrost can be started when the difference between **dPA** and **dPb** probes is lower than **dtP** for all **ddP** time. This is useful to start defrost when a low thermal exchange is detected. If [**ddP** = 0], this function is disabled.

### 12.5.2 Minimum Defrost Time

The "**ndt**" (0 to MnF) Minimum Defrost Time, set the minimum defrost duration, when the defrost is ended by evaporator temperature probe.

The **ndt** time is taken in account every time the defrost is triggered, independently from the value of end defrost temperature probe and end defrost digital input status.

### 12.5.3 Defrost Ending

- When defrost is started via **rtC**, the maximum defrost duration is obtained from the **Md** parameter and the defrost end temperature is obtained from the **dtE** parameter (and **dtS** if two defrost probes are selected).
- If **dPA** and **dPb** are present and [**d2P** = Y], the device stops the defrost procedure when **dPA** is higher than **dtE** temperature and **dPb** is higher than **dtS** temperature.

At the end of defrost, the drip time is controlled through the **Fdt** parameter.

### 12.5.4 Kind of Defrost

The kind of defrost is set by parameter **tdF** among the following possibilities.

**tdF = Air: natural defrost.** Defrost is made by opening the compressor/solenoid relay. The fan during defrost depends on the parameter **Fnc**. Defrost relay is off. The valve is closed

**tdF = EL: defrost with electrical heater:** Defrost is made by opening the compressor/solenoid relay. The fan during defrost depends on the parameter **Fnc**. Defrost relay is on. The valve is closed

**tdF = in: hot gas defrost.** Defrost is made by closing the compressor/solenoid relay. The fan during defrost depends on the parameter **Fnc**. Defrost relay is on. The valve opening percentage during the defrost is set by the par. **oPd**.

## 12.6 On Demand Defrost

### 12.6.1 Description

Controller can perform on demand defrost. It is based on the behavior of evaporator temperature.

Controller monitors the evaporator temperature and triggers a defrost if some conditions are satisfied. For defrost efficiency it is important to place the "end defrost probe", usually P2, in the coldest place of the evaporator, usually immediately after the expansion valve.

**NOTE: Because of different type of evaporators and consequentially behaviors, it is recommended to test and validate this algorithm in a climatic chamber before applying it in the field.**

### 12.6.2 Parameters and Settings

The «On Demand Defrost» can be activated with the following settings:

**CrE="n", EdF="Aut"**

**cdt: evaporator temperature differential to trigger a defrost** (default **cdt** = 4°K)

**nbd: minimum compressor run before automatic defrost** (or minimum time of activation of solenoid valve) it has to be set properly. It prevents defrost from starting (default **nbd** = 4.0 hours)

**Mbd: max compressor run before automatic defrost** (or max time of activation of solenoid valve): it has to be set properly. If reached a defrost is triggered (default **Mbd** = 16.0 hours)

**nct: minimum evap. temperature**, it has to be set properly. a defrost is triggered when this temperature reached (default **nct** = -30°C)

**NOTE:** With **CrE="y"** or **CrE="EUP"** or **CrE=EU5** only «RTC defrost» and «interval defrost» are allowed. With **EdF="Aut"** & **CrE="y"** or **CrE="EUP"** or **CrE=EU5** the «interval defrost» will be performed, as with **EdF = in**

### 12.6.3 Exceptions

1. A defrost cannot be triggered if the compressor has not ran more than minimum time (**nbd** parameter) since the last defrost or initial power up. (Resolution hh.m)
2. If the compressor has ran for more than maximum time since the last defrost or initial power up (**Mbd** parameter), a defrost is triggered regardless of coil temperature.
3. If the coil temperature reaches very low temperature, (**nct** parameter), a defrost is triggered regardless of **cdt** value.

## 12.7 Fans

### 12.7.1 Control with Relay

The fan control mode is selected by means of the **FnC** parameter:

- **C-n** = running with the solenoid valve, OFF during defrost
- **C-Y** = running with the solenoid valve, ON during defrost
- **O-n** = continuous mode, OFF during defrost
- **O-Y** = continuous mode, ON during defrost

An additional parameter **FSt** provides the setting of the temperature, detected by the evaporator probe, above which the fans are always OFF. This can be used to verify that air is circulated only if this temperature is lower than set in the **FSt**.

### 12.7.2 Control With Analog Output (If Present)

The regulation probe is set in the parameter **FAP**.

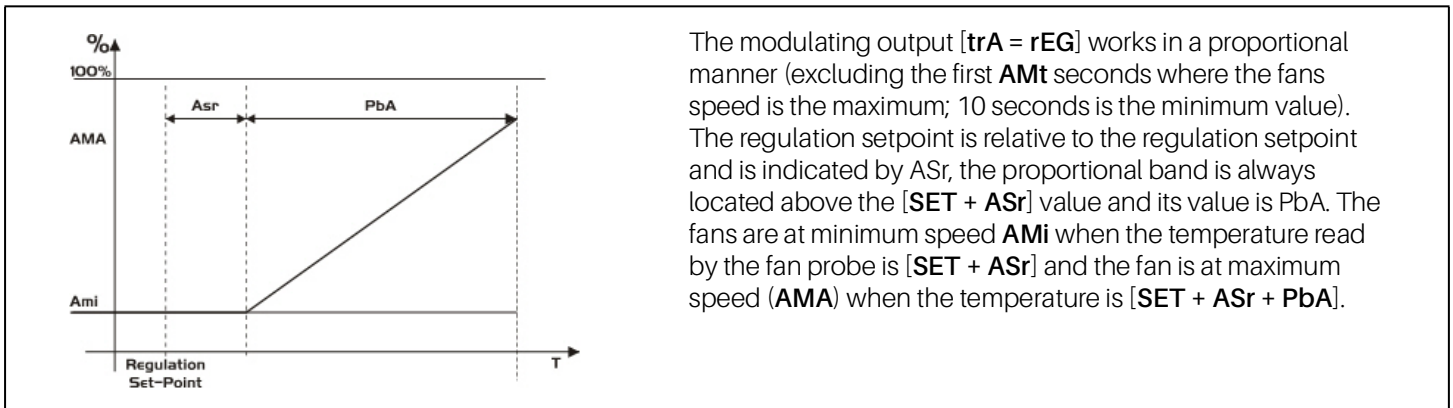


Figure 12-1 - Control With Analog Output

**NOTE:** to use properly this function **FAP** has to be set as the thermostat probe.

## 12.8 Anti-Sweat Heaters

Anti-sweat heater regulation can be performed with the on board relay (if **OA6** = **AC**) or with the analog output (if present by setting **trA** = **AC**). However, the regulation can be performed in two ways:

- Without real dewpoint information: in this case the default value for dewpoint is used (**SdP** parameter).
- Receiving dewpoint from **XWEB5000** system: the **SdP** parameter is overwritten when a valid value for dewpoint is received from XWEB. In case the XWEB link is lost, **SdP** is the value that will be used for safety.

The best performance can be obtained using probe 4. In this case, the regulation follows the chart illustrated in **Figure 12-2**:

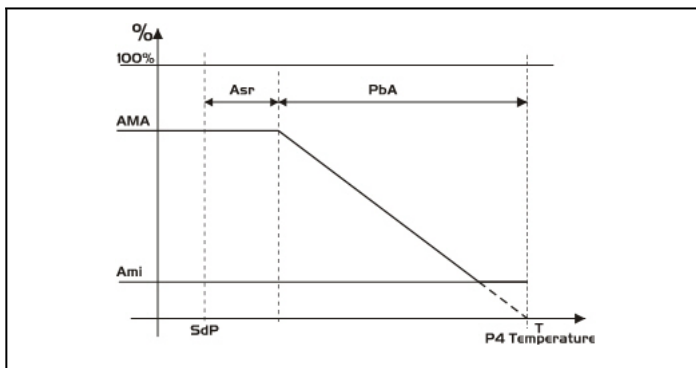


Figure 12-2 - Anti-Sweat Heaters

## Functioning with Probe 4 within the LAN:

Table 12-1 - Functioning with Probe 4 within the LAN

Parameter	XM6x8D_1 Without Probe 4	XM6x8D_2 + With Probe 4	XM6x8D_3+ Without Probe 4
Adr	n	n + 1	n + 2
LCP	LCP = n	LCP = Y	LCP = n
P4C	LAN or probe not connected	P4C = NTC, PtC or PtM	LAN or probe not connected
trA	trA = AC if the device has the analog output		
OA6	OA6 = AC if the device will use the AUX relay for regulation		

## Functioning Without Probe 4:

Table 12-2 - Functioning Without Probe 4

Parameter	XM6x8D Without Probe 4
P4C	nP
AMt	% of ON

In this case, regulation is performed by switching the auxiliary relay ON and OFF on a 60-minutes time base. The ON time will be the **AMt** value, so that the relay will be ON for **AMt** minutes and OFF for **[60-AMt]** minutes.

In case of P4 error or if P4 is absent, the output is at **AMA** value for the **AMt** time then the output is at 0 value for the time **[255 - AMt]** time performing a simple PWM modulation.

## 12.9 Cleaning Mode Function by Digital Input Configuration

The "cLn" value is added to the functions of the digital input.

The function has the same basic features of the stand by function, but with the following differences:

- By the parameter LcL (No, Yes) it is possible to set if the light is on or off during cleaning mode. This parameter LcL can be override by light button or by Light on/off MODBUS command.
- By the parameter FcL (No, Yes) it is possible to set if the fan is on or off during cleaning mode. In case of fan on, the FSt parameter (fan stop temperature) is override.

### 12.9.1 Display

During the Cleaning Status, the display shows the "cLn" message.

## 12.10 Auxiliary Output

The auxiliary output is switched ON and OFF by means of the corresponding digital input or by pressing and releasing the down arrow key.

## 13 Parameter List

Table 13-1 - Parameter List

Parameter	Description
REGULATION	
rtC	Access to CLOCK submenu (if present)
Set	<b>Temperature setpoint</b> (LS to US)
Hy	Differential: (0,1 to 25, 5°C; 1 to 45°F): Intervention differential for setpoint, always positive. Solenoid valve Cut IN is Setpoint Plus Differential (Hy). Solenoid valve Cut OUT is when the temperature reaches the setpoint.
LS	<b>Minimum setpoint limit:</b> (-55.0°C to SET; -67°F to SET) Sets the minimum acceptable value for the setpoint.
US	<b>Maximum setpoint limit:</b> (SET to 150°C; SET to 302°F) Set the maximum acceptable value for setpoint.
OdS	<b>Outputs activation delay at start up:</b> (0 to 255 minutes) This function is enabled at the initial start up of the instrument and inhibits any output activation for the period of time set in the parameter. (AUX and Light can work)
AC	<b>Anti-short cycle delay:</b> (0 to 60 minutes) interval between the solenoid valve stop and the following restart.
CCt	<b>Compressor ON time during continuous cycle:</b> (0.0 to 24.0 hours; resolution 10 minutes) Allows to set the length of the continuous cycle: compressor stays on without interruption for the CCt time. Can be used, for instance, when the room is filled with new products.
CCS	<b>Setpoint for continuous cycle:</b> (-55 to 150°C / -67 to 302°F) it sets the setpoint used during the continuous cycle.
Con	<b>Solenoid valve ON time with faulty probe:</b> (0 to 255 minutes) time during which the solenoid valve is active in case of faulty thermostat probe. With CON = 0 solenoid valve is always OFF.
CoF	<b>Solenoid valve OFF time with faulty probe:</b> (0 to 255 minutes) time during which the solenoid valve is off in case of faulty thermostat probe. With COF = 0 solenoid valve is always active.
DISPLAY	
CF	Temperature measurement unit: °C = Celsius; °F = Fahrenheit. <b>WARNING:</b> When the measurement unit is changed the parameters with temperature values have to be checked.
rES	<b>Resolution (for °C):</b> (in = 1°C; dE = 0.1 °C) allows decimal point display.
Lod	<b>Instrument display:</b> (nP; P1; P2, P3, P4, P5, P6, tEr, dEF) it selects which probe is displayed by the instrument. <b>P1, P2, P3, P4, P5, P6, tEr</b> = virtual probe for thermostat, <b>dEF</b> = virtual probe for defrost.
rEd	<b>Remote display:</b> (nP; P1; P2, P3, P4, P5, P6, tEr, dEF) it selects which probe is displayed by the X-REP. <b>P1, P2, P3, P4, P5, P6, tEr</b> = virtual probe for thermostat, <b>dEF</b> = virtual probe for defrost.
dLy	<b>Display delay:</b> (0 to 24.0 minutes; resolution 10 seconds) when the temperature increases, the display is updated of 1 °C/1°F after this time.

Table 13-1 - Parameter List

Parameter	Description
rPA	<b>Regulation probe A:</b> (nP; P1; P2, P3, P4, P6) first probe used to regulate room temperature. If rPA=nP the regulation is performed with real value of rPb.
rPb	<b>Regulation probe B:</b> (nP; P1; P2, P3, P4, P5) second probe used to regulate room temperature. If rPb=nP the regulation is performed with real value of rPA.
rP3	<b>Regulation probe 3:</b> (nP; P1; P2, P3, P4, P6) third probe used to regulate room temperature, with rPd = rAb, Aur, LoE, HiE.
rP4	<b>Regulation probe 4:</b> (nP; P1; P2, P3, P4, P6) fourth probe used to regulate room temperature, with rPd = rAb, Aur, LoE, HiE.
rPd	<b>Temperature Regulation Strategy:</b> (rPA, rAb, Aur, LoE, HiE. ) <b>rPA:</b> Temperature detected by the probe set in the parameter rPA. <b>rAb:</b> Mix between rPA and rPb defined by rPE parameter. <b>Aur:</b> Average temperature of all the probes defined as Regulation Probe in the parameters rPA, rPb, rP3, rP4. <b>LoE:</b> Minimum value among all the temperature probes defined as Regulation Probe in the parameters rPA, rPb, rP3, rP4. <b>HiE:</b> Maximum value among all the temperature probes defined as Regulation Probe in the parameters rPA, rPb, rP3, rP4.
rPE	<b>Regulation virtual probe percentage:</b> (0 to 100%) it defines the percentage of the rPA respect to rPb. The value used to regulate room temperature is obtained by: <b>Value_for_room = (rPA*rPE + rPb*(100-rPE))/100</b>
DEFROST	
dPA	<b>Defrost Probe A:</b> (nP; P1; P2, P3, P4, P6) first probe used for defrost.
dPb	<b>Defrost Probe B:</b> (nP; P1; P2, P3, P4, P6) second probe used for defrost.
tdF	<b>Defrost type:</b> (Air, EL, in) <b>Air</b> = Air defrost (relay is not switched on during defrost) <b>EL</b> = Defrost with electrical heater. <b>in</b> = Hot gas defrost.
EdF	<b>Defrost mode:</b> (rtc - in- Aut) ( <b>only if RTC is present</b> ) <b>rtc</b> = defrost activation via RTC; <b>in</b> = defrost activation with <b>idf</b> ; <b>AUT</b> = on demand defrost.
Srt	<b>Heater setpoint during defrost:</b> (-55.0 to 150.0°C; -67 to 302°F) if <b>tdF</b> = <b>EL</b> during the defrost the defrost relay perform an ON/OFF regulation with Srt as setpoint.
Hyr	<b>Differential for heater:</b> (0.1°C to 25.5°C, 1°F to 45°F) the differential for heater.
tod	<b>Time out for heater:</b> 0 to 255 minutes if the defrost probe temperature is bigger than <b>Srt</b> for all <b>tod</b> time the defrost ends although the defrost probe temperature is lower than dtE or dtS. It permits to reduce defrost duration.
d2P	<b>Defrost with two probes:</b> (N - Y) N = only the dPA probe is used to defrost management; Y= defrost is managed with <b>dPA</b> probe and <b>dPb</b> probe. Defrost can performed only if both probe value are lower than dtE for dPA probe and dtS for dPb probe.
dtE	<b>Defrost termination temperature (Probe A):</b> (-55,0 to 50,0°C; -67 to 122°F) (Enabled only when the evaporator probe is present) sets the temperature measured by the evaporator probe <b>dPA</b> which causes the end of defrost.

Table 13-1 - Parameter List

Parameter	Description
dtS	<b>Defrost termination temperature (Probe B):</b> (-55,0 to 50,0°C; -67 to 122°F) (Enabled only when the evaporator probe is present) sets the temperature measured by the evaporator probe <b>dPb</b> which causes the end of defrost.
IdF	<b>Interval between defrosts:</b> (0 to 120 hours) Determines the time interval between the beginning of two defrost cycles.
idE	Time to next defrost log into not volatile memory <b>No:</b> Time to next defrost is not logged into no volatile memory, this means controller will use the idF interval after a power off. <b>E.I.</b> idF = 8: controller performs a defrost every 8 hours. If controller is switched off, independently from when last defrost happened, at power on it will do the first defrost after 8 hours. <b>Yes:</b> Time to next defrost is logged into no volatile memory, this means controller will use it after a power off. <b>E.I.</b> idF = 8: controller performs a defrost every 8 hours. If controller is switched off 6 hours after last defrost, at power on it will do the first defrost after 2 hours (6+2 = 8). It is useful in places subjected to frequent power outages.
ndt	<b>Minimum duration of defrost:</b> (0 to MdF minutes) it sets the minimum defrost duration, independently from the temperature reached by the end defrost probes.
MdF	<b>Maximum duration of defrost:</b> (ndt to 255 minutes) When <b>dPA</b> and <b>dPb</b> are not present, it sets the defrost duration, otherwise it sets the maximum duration for defrost.
dSd	<b>Start defrost delay:</b> (0 to 255 minutes) This is useful when different defrost start times are necessary to avoid overloading the plant.
dFd	<b>Display during defrost:</b> <b>rt</b> = real temperature; <b>it</b> = temperature reading at the defrost start; <b>Set</b> = setpoint; <b>dEF</b> = "dEF" label.
dAd	<b>Defrost display time out:</b> (0 to 255 minutes) Sets the maximum time between the end of defrost and the restarting of the real room temperature display.
Fdt	<b>Drain down time:</b> (0 to 255 minutes) time interval between reaching defrost termination temperature and the restoring of the control's normal operation. This time allows the evaporator to eliminate water drops that might have formed due to defrost.
dPo	<b>First defrost after start-up:</b> <b>Y</b> = Immediately; <b>N</b> = after the IdF time
dAF	<b>Defrost delay after continuous cycle:</b> (0 to 23.5 hours) time interval between the end of the fast freezing cycle and the following defrost related to it.
<b>PUMP DOWN</b>	
Pdt	<b>Pump down type (nu, FAn, F-C)</b> <b>nu:</b> pump down disabled <b>FAn:</b> pump down enabled. Fan is activated for pump down duration, compressor relay/solenoid valve is switched off with CrE = N/Y o or activated with CrE = EUP or EU5. <b>F-C:</b> pump down enabled. Fan and compressor relay are activated for pump down duration. See above for solenoid valve behavior.
Pdn	Pump down duration (0 to 255 minutes)

Table 13-1 - Parameter List

Parameter	Description
<b>ON DEMAND DEFROST</b>	
Ctd	Differential for defrost start (0.1°C to 25.5°C, 1°F to 45°F)
nbd	Minimum Compressor run time before defrost 0.0 to 24h00 minutes)
Mdb	Maximum Compressor run time before defrost (0.0 to 24h00 minutes)
nct	Minimum coil temperature to trigger a defrost (-55.0°C to 150.0°C; 67°F to 302°F)
<b>FAN</b>	
FAP	Fan probe A: (nP; P1; P2, P3, P4, P5) first probe used for fan.
FnC	Fan operating mode: <b>C-n</b> = running with the solenoid valve, OFF during the defrost; <b>C-y</b> = running with the solenoid valve, ON during the defrost; <b>O-n</b> = continuous mode, OFF during the defrost; <b>O-y</b> = continuous mode, ON during the defrost.
Fnd	Fan delay after defrost: (0 to 255 minutes) The time interval between the defrost end and evaporator fans start.
FCt	Temperature differential avoiding short cycles of fans (0.0°C to 50.0°C; 0°F to 90°F) If the difference of temperature between the evaporator and the room probes is more than the value of the Fct parameter, the fans are switched on.
FSt	Fan stop temperature: (-50 to 110°C; -58 to 230°F) setting of temperature, detected by evaporator probe, above which the fan is always OFF.
FHy	Differential to restart fan: (0.1°C to 25.5°C) (1°F to 45°F) when stopped, fan restarts when fan probe reaches FSt-FHy temperature.
tFE	Fan regulation by temperature during defrost (N,Y)
Fod	Fan activation time after defrost: (0 to 255 minutes) it forces fan activation for indicated time.
Fon	Fan ON time: (0 to 15 minutes) <b>with</b> Fnc = C_n or C_y, (fan activated in parallel with compressor). It sets the evaporator fan ON cycling time when the compressor is off. With Fon =0 and FoF ≠ 0 the fan are always off, with Fon=0 and FoF =0 the fan are always off.
FoF	Fan OFF time: (0 to 15 minutes) <b>with</b> Fnc = C_n or C_y, (fan activated in parallel with compressor). It sets the evaporator fan off cycling time when the compressor is off. With Fon =0 and FoF ≠ 0 the fan are always off, with Fon=0 and FoF =0 the fan are always off.
<b>MODULATING OUTPUT - if present</b>	
trA	Kind of regulation with PWM output: (UAL – rEG – AC) it selects the functioning for the PWM output. UAL= the output is at FSA value; rEG = the output is regulated with fan algorithm described in fan section; AC= anti-sweat heaters control (require the XWEB5000 system).
SOA	Fixed value for analog output: (0 to 100%) value for the output if trA=UAL.
SdP	Default value for Dewpoint: (-55,0 to 50,0°C; -67 to 122°F) default value of dewpoint used when there is no supervising system (XWEB5000). Used only when trA = AC.
ASr	Dew-point offset (trA=AC) / Differential for modulating fan regulation (trA = rEG): (-25.5°C to 25.5°C) (-45°F to 45°F).
PbA	Differential for anti-sweat heaters: (0.1°C to 25.5°C) (1°F to 45°F)

Table 13-1 - Parameter List

Parameter	Description
AMi	Minimum value for analog output: (0 to AMA)
AMA	Maximum value for analog output: (Ami to 100)
AMt	Anti-sweat heaters cycle period (trA=AC)/ Time with fan at maximum speed (trA=rEG): (0 to 255 seconds) when the fan starts, during this time the fan is at maximum speed.
ALARMS	
rAL	Probe for temperature alarm: (nP - P1 - P2 - P3 - P4 - P5 - tEr) it selects the probe used to signal alarm temperature.
ALC	Temperature alarm configuration: rE = High and Low alarms related to Setpoint; Ab = High and low alarms related to the absolute temperature.
ALU	High temperature alarm setting: (ALC= rE, 0 to 50°C or 90°F / ALC= Ab, ALL to 150°C or 302°F) when this temperature is reached and after the ALd delay time the HA alarm is enabled.
ALL	Low temperature alarm setting: (ALC = rE, 0 to 50 °C or 90°F / ALC = Ab, - 55°C or - 67°F to ALU) when this temperature is reached and after the ALd delay time, the LA alarm is enabled.
AHy	Differential for temperature alarm: (0.1°C to 25.5°C / 1°F to 45°F) Intervention differential for recovery of temperature alarm.
ALd	Temperature alarm delay: (0 to 255 minutes) time interval between the detection of an alarm condition and the corresponding alarm signaling.
rA2	Probe for second temperature alarm: (nP - P1 - P2 - P3 - P4 - P5 - tEr) it selects the probe used to signal alarm temperature.
A2U	Second high temperature alarm setting: (A2L to 150°C or 302°F) when this temperature is reached and after the A2d delay time the HA2 alarm is signaled.
A2L	Second Low temperature alarm setting: (- 55°C or - 67°F to A2U) when this temperature is reached and after the A2d delay time, the LA2 alarm is signaled.
A2H	Differential for second temperature alarm: (0.1°C to 25.5°C / 1°F to 45°F) Intervention differential for recovery of second temperature alarm.
Ad2	Second temperature alarm delay: (0 to 255 minutes) time interval between the detection of second temperature alarm condition and the corresponding alarm signaling.
dAO	Delay of temperature alarm at start-up: (0 minutes to 23 hours, 50 minutes) time interval between the detection of the temperature alarm condition after the instrument power on and the alarm signaling.
EdA	Alarm delay at the end of defrost: (0 to 255 minutes) Time interval between the detection of the temperature alarm condition at the end of defrost and the alarm signaling.
dot	Temperature alarm exclusion after door open: (0 to 255 minutes)
tbA	Disabling alarm relay by pressing a key: (N; Y)

Table 13-1 - Parameter List

Parameter	Description
<b>OPTIONAL OUTPUT (Only for XM670K)</b>	
<b>oA5</b>	<b>Relay at term. 1-2-3 configuration: (nP - CPr -CP2- -dEF-Fan-ALr-LiG-AUS-Htr-OnF - AC):</b> <b>nP</b> = not used; <b>CPr</b> = relay works as a compressor or solenoid valve relay; <b>CP2</b> = relay works as second <b>dEF</b> = relay works as defrost relay; <b>Fan</b> = relay works as a Fan relay; <b>ALr</b> = activation with alarm conditions; <b>LiG</b> = light activation; <b>AUS</b> = auxiliary relay, it can be switched ON/OFF also by key; <b>Htr</b> = dead band regulation ( <b>not compatible with CrE=y</b> ); <b>OnF</b> = ON/OFF functioning, <b>AC</b> = anti-sweat heaters.
<b>oA6</b>	<b>Relay at term. 17-18 configuration: nP - CPr -CP2- -dEF-Fan-ALr-LiG-AUS-Htr-OnF - AC):</b> <b>nP</b> = not used; <b>CPr</b> = relay works as a compressor or solenoid valve relay; <b>CP2</b> = relay works as second <b>dEF</b> = relay works as defrost relay; <b>Fan</b> = relay works as a Fan relay; <b>ALr</b> = activation with alarm conditions; <b>LiG</b> = light activation; <b>AUS</b> = auxiliary relay, it can be switched ON/OFF also by key; <b>Htr</b> = dead band regulation ( <b>not compatible with CrE = y</b> ); <b>OnF</b> = ON/OFF functioning, <b>AC</b> = anti-sweat heaters.
<b>CoM</b>	Type of functioning modulating output: <b>For models with PWM / O.C. output to PM5=</b> PWM 50Hz; <b>PM6=</b> PWM 60Hz; <b>OA7=</b> not set it; <b>For models with 4 to 20mA / 0 to 10V output to Cur=</b> 4 to 20mA current output; <b>tEn=</b> 0 to 10V voltage output.
<b>AOP</b>	<b>Alarm relay polarity: cL=</b> normally closed; <b>oP=</b> normally opened.
<b>iAU</b>	<b>Auxiliary output is unrelated to ON/OFF device status: N=</b> if the instrument is switched off also the auxiliary output is switched off; <b>Y=</b> the auxiliary output state is unrelated to the ON/OFF device status.
<b>DIGITAL INPUTS</b>	
<b>i1P</b>	<b>Digital input 1 polarity: (cL - oP) CL:</b> the digital input is activated by closing the contact; <b>OP:</b> the digital input is activated by opening the contact.
<b>i1F</b>	<b>Digital input 1 function: (nu - EAL - bAL - PAL - dor - dEF - AUS - LiG - OnF - Htr - FHU - ES - Hdy)</b> <b>nu</b> = not used; <b>EAL</b> = external alarm; <b>bAL</b> = serious external alarm; <b>PAL</b> = pressure switch activation; <b>dor</b> = door open; <b>dEF</b> = defrost activation; <b>AUS</b> = auxiliary activation; <b>LiG</b> = light activation; <b>OnF</b> = switch on/off the instrument; <b>FHU</b> = not used; <b>ES</b> = activate energy saving; <b>nt</b> = second map enabling; <b>cLn</b> = clean function <b>dEn</b> = defrost off, <b>CP1</b> = compressor 1 safety, <b>CP2</b> = compressor 2 safety.
<b>d1d</b>	<b>Time interval/delay for digital input alarm: (0 to 255 minutes)</b> Time interval to calculate the number of the pressure switch activation when <b>i1F=PAL</b> . If <b>i1F=EAL</b> or <b>bAL</b> (external alarms), " <b>d1d</b> " parameter defines the time delay between the detection and the successive signaling of the alarm. If <b>i1F=dor</b> this is the delay to activate door open alarm.
<b>i2P</b>	<b>Digital input 2 polarity: (cL - oP) CL:</b> the digital input is activated by closing the contact; <b>OP:</b> the digital input is activated by opening the contact.
<b>i2F</b>	<b>Digital input 2 function: (nu - EAL - bAL - PAL - dor - dEF - AUS - LiG - OnF - Htr - FHU - ES - Hdy)</b> <b>nu</b> = not used; <b>EAL</b> = external alarm; <b>bAL</b> = serious external alarm; <b>PAL</b> = pressure switch activation; <b>dor</b> = door open; <b>dEF</b> = defrost activation; <b>AUS</b> = auxiliary activation; <b>LiG</b> = light activation; <b>OnF</b> = switch on/ off the instrument; <b>FHU</b> = not used; <b>ES</b> = activate energy saving; <b>nt</b> = second map enabling; <b>cLn</b> = clean function <b>dEn</b> = defrost off, <b>CP1</b> = compressor 1 safety, <b>CP2</b> = compressor 2 safety.
<b>d2d</b>	<b>Time interval/delay for digital input alarm: (0 to 255 minutes)</b> Time interval to calculate the number of the pressure switch activation when <b>i2F=PAL</b> . If <b>i2F=EAL</b> or <b>bAL</b> (external alarms), " <b>d2d</b> " parameter defines the time delay between the detection and the successive signaling of the alarm. If <b>i2F=dor</b> this is the delay to activate door open alarm.
<b>i3P</b>	<b>Digital input 3 polarity: (cL - oP) CL:</b> the digital input is activated by closing the contact; <b>OP:</b> the digital input is activated by opening the contact.

Table 13-1 - Parameter List

Parameter	Description
i3F	<b>Digital input 3 function:</b> (nu - EAL - bAL - PAL - dor - dEF - AUS - LiG - OnF - Htr - FHU - ES - HdY) <b>nu</b> = not used; <b>EAL</b> = external alarm; <b>bAL</b> = serious external alarm; <b>PAL</b> = pressure switch activation; <b>dor</b> = door open; <b>dEF</b> = defrost activation; <b>AUS</b> = auxiliary activation; <b>LiG</b> = light activation; <b>OnF</b> = switch on/off the instrument; <b>FHU</b> = not used; <b>ES</b> = activate energy saving; <b>nt</b> = second map enabling; <b>cLn</b> = clean function <b>dEn</b> = defrost off, <b>CP1</b> = compressor 1 safety, <b>CP2</b> = compressor 2 safety.
d3d	<b>Time interval/delay for digital input alarm:</b> (0 to 255 minutes) Time interval to calculate the number of the pressure switch activation when i3F= <b>PAL</b> . If i3F= <b>EAL</b> or <b>bAL</b> (external alarms), " <b>d3d</b> " parameter defines the time delay between the detection and the successive signaling of the alarm. If i3F= <b>dor</b> this is the delay to activate door open alarm.
nPS	<b>Pressure switch number:</b> (0 to 15) Number of activation of the pressure switch, during the " <b>d#d</b> " interval, before signaling the alarm event (i2F= <b>PAL</b> ). <b>If the nPS activation in the did time is reached, switch off and on the instrument to restart normal regulation.</b>
odc	<b>Compressor and fan status when open door:</b> <b>no</b> = normal; <b>Fan</b> = Fan OFF; <b>CPr</b> = Compressor OFF; <b>F_C</b> = Compressor and fan OFF.
rrd	<b>Outputs restart after doA alarm:</b> <b>No</b> = outputs not affected by the doA alarm; <b>Yes</b> = outputs restart with the doA alarm.
<b>RTC SUBMENU (if present)</b>	
CbP	<b>Clock Presence</b> (N to Y): permits disabling or enabling of the clock.
Hur	<b>Current hour</b> (0 to 23 hours)
Min	<b>Current minute</b> (0 to 59 minutes)
dAY	<b>Current day</b> (Sun to Sat)
Hd1	<b>First weekly holiday</b> (Sun to nu) Set the first day of the week that follows the holiday times.
Hd2	<b>Second weekly holiday</b> (Sun to nu) Set the second day of the week that follows the holiday times.
Hd3	<b>Third weekly holiday</b> (Sun to nu) Set the third day of the week that follows the holiday times.
ILE	<b>Energy Saving cycle start during workdays:</b> (0 to 23 hours, 50 minutes) During the Energy Saving cycle the setpoint is increased by the value in HES so that the operation setpoint is SET + HES.
dLE	<b>Energy Saving cycle length during workdays:</b> (0 to 24 hours 00 minutes) Sets the duration of the Energy Saving cycle on workdays.
ISE	<b>Energy Saving cycle start on holidays.</b> (0 to 23 hours 50 minutes)
dSE	<b>Energy Saving cycle length on holidays</b> (0 to 24 hours 00 minutes)
Ld1 to Ld6	<b>Workday defrost start</b> (0 to 23 hours 50 minutes) These parameters set the beginning of the 6 programmable defrost cycles during workdays. For example, when <b>Ld2</b> = 12.4 the second defrost starts at 12.40 during workdays.
Sd1 to Sd6	<b>Holiday defrost start</b> (0 to 23 hours 50 minutes) These parameters set the beginning of the 6 programmable defrost cycles on holidays. For example, when <b>Sd2</b> = 3.4 the second defrost starts at 3.40 on holidays.

Table 13-1 - Parameter List

Parameter	Description
<b>ENERGY SAVING</b>	
HES	<b>Temperature increase during the Energy Saving cycle:</b> (-30 to 30°C / -54 to 54°F) sets the increasing value of the setpoint during the Energy Saving cycle.
PEL	<b>Energy saving activation when light is switched off:</b> (N to Y) <b>n</b> = function disabled. <b>Lig</b> = energy saving is activated when the light is switched off and vice versa. <b>AUS</b> = energy saving is activated when the AUX is switched off and vice versa. <b>LEA</b> = energy saving is activated when the light & the AUX relays are switched off and vice versa.
<b>LAN MANAGEMENT</b>	
LMd	<b>Defrost synchronization:</b> <b>Y</b> = the section send a command to start defrost to other controllers, <b>N</b> = the section that will not send a global defrost command.
dEM	<b>Type of end defrost:</b> <b>N</b> = the of the LAN defrost are independent; <b>Y</b> = the end of the defrost are synchronization.
LSP	<b>L.A.N. setpoint synchronization:</b> <b>Y</b> = the section setpoint, when modified, is updated to the same value on all the other sections; <b>N</b> = the setpoint value is modified only in the local section.
LdS	<b>L.A.N. display synchronization:</b> <b>Y</b> = the value displayed by the section is sent to all the other sections; <b>N</b> = the setpoint value is modified only in the local section.
LOF	<b>L.A.N. On/Off synchronization</b> this parameter states if the On/Off command of the section will act on all the other ones too: <b>Y</b> = the On/Off command is sent to all the other sections; <b>N</b> = the On/Off command acts only in the local section.
LLi	<b>L.A.N. light synchronization</b> this parameter states if the light command of the section will act on all the other ones too: <b>Y</b> = the light command is sent to all the other sections; <b>N</b> = the light command acts only in the local section.
LAU	<b>L.A.N. AUX output synchronization</b> this parameter states if the AUX command of the section will act on all the other ones too: <b>Y</b> = the light command is sent to all the other sections; <b>N</b> = the light command acts only in the local section.
LES	<b>L.A.N. energy saving synchronization</b> this parameter states if the energy saving command of the section will act on all the other ones too: <b>Y</b> = the Energy Saving command is sent to all the other sections; <b>N</b> = the Energy Saving command acts only in the local section.
LSd	<b>Remote probe display:</b> this parameter states if the section has to display the local probe value or the value coming from another section: <b>Y</b> = the displayed value is the one coming from another section (that has parameter LdS = y); <b>N</b> = the displayed value is the local probe one.
LCP	<b>P4 probe sent via LAN</b> (N, Y)
StM	<b>Cooling activation via LAN:</b> <b>N</b> = not used; <b>Y</b> = a generic cooling requests from LAN activate the solenoid valve connected to compressor relay.
ACE	<b>Cold Calling in LAN always enabled even if the compressor block:</b> (N,Y)

Table 13-1 - Parameter List

Parameter	Description
<b>PROBE CONFIGURATION</b>	
<b>P1C</b>	<b>Probe 1 configuration:</b> (nP – Ptc – ntc – PtM) <b>nP</b> = not present; <b>PtC</b> = Ptc; <b>ntc</b> = NTC; <b>PtM</b> = Pt1000
<b>OF1</b>	<b>Probe 1 calibration:</b> (-12.0 to 12.0°C/ -21 to 21°F) allows to adjust possible offset of the thermostat probe.
<b>P2C</b>	<b>Probe 2 configuration:</b> (nP – Ptc – ntc – PtM) <b>nP</b> = not present; <b>PtC</b> = Ptc; <b>ntc</b> = NTC; <b>PtM</b> = Pt1000.
<b>OF2</b>	<b>Probe 2 calibration:</b> (-12.0 to 12.0°C/ -21 to 21°F) allows to adjust possible offsets of the evaporator probe.
<b>P3C</b>	<b>Probe 3 configuration:</b> (nP – Ptc – ntc – PtM) <b>nP</b> = not present; <b>PtC</b> = Ptc; <b>ntc</b> = NTC; <b>PtM</b> = Pt1000.
<b>OF3</b>	<b>Probe 3 calibration:</b> (-12.0 to 12.0°C/ -21 to 21°F) allows to adjust possible offset of the probe 3.
<b>P4C</b>	<b>Probe 4 configuration:</b> (nP – Ptc – ntc – PtM) <b>nP</b> = not present; <b>PtC</b> = Ptc; <b>ntc</b> = NTC; <b>PtM</b> = Pt1000.
<b>OF4</b>	<b>Probe 4 calibration:</b> (-12.0 to 12.0°C/ -21 to 21°F) allows to adjust possible offset of the probe 4.
<b>SERVICE - OTHERS</b>	
<b>LCL</b>	<b>Light on during cleaning mode</b> (N,Y)
<b>FCL</b>	<b>Fan on during cleaning mode</b> (N,Y)
<b>MAP</b>	<b>Map used during standard operation (1°M, 2°M, 3°M, 4°M)</b> It sets the map used by the controller among the four possible maps.
<b>MP1</b>	Alternate Map enabled by digital input or MODBUS command (1°M, 2°M, 3°M, 4°M) It sets the alternate map enabled by digital input or MODBUS command among the four possible maps.
<b>CLt</b>	Cooling time percentage: it shows the effective cooling time calculated by XM600 during regulation.
<b>tMd</b>	Time to next defrost: it shows time before the next defrost if interval defrost is selected.
<b>LSn</b>	L.A.N. section number (1 to 8) Shows the number of sections available in the L.A.N.
<b>Lan</b>	L.A.N. serial address (1 to LSn) Identifies the instrument address inside local network of multiplexed cabinet controller.
<b>Adr</b>	RS485 serial address (1 to 247): Identifies the instrument address when connected to a MODBUS compatible monitoring system.
<b>br</b>	It sets the baud rate among: (96 = 9.6 bit/s; 192 = 19.2 bit/s)
<b>EMU</b>	Previous versions emulation (2V8, 3V8, 4V2) It allows the controller to be used in a LAN of controllers with previous versions: 2V8 = it emulates version 2.8 3V8 = it emulates version 3.8 4V2 = it emulates version 4.2
<b>rEL</b>	Release software: (read only) Software version of the microprocessor.
<b>SrL</b>	Software sub-release: (read only) for internal use
<b>Ptb</b>	Parameter table: (read only) it shows the original code of the Copeland parameter map.
<b>Pr2</b>	Access to the protected parameter list (read only).

## 14 Digital Inputs

The XM600 series can support up to 3 free of voltage contact configurable digital inputs (depending on the models). They are configurable via i#F parameter

### 14.1 Generic Alarm (EAL)

As soon as the digital input 1, 2, or 3 is activated the unit will wait for “**d1d**” or “**d2d**” or “**d3d**” time delay before signaling the “**EAL**” alarm message. The outputs status do not change. The alarm stops just after the digital input is deactivated.

### 14.2 Serious Alarm Mode (BAL)

When the digital input is activated, the unit will wait for “**d1d**” or “**d2d**” or “**d3d**” delay before signaling the “**BAL**” alarm message. The relay outputs are switched OFF. The alarm will stop as soon as the digital input is deactivated.

### 14.3 Pressure Switch (PAL)

If during the interval time set by “**d1d**” or “**d2d**” or “**d3d**” parameter, the pressure switch has reached the number of activation of the “**nPS**” parameter, the “**CA**” pressure alarm message will be displayed. The compressor and the regulation are stopped. When the digital input is ON the compressor is always OFF. **If the nPS activation in the d#d time is reached, switch off and on the instrument to restart normal regulation.**

### 14.4 Door Switch Input (dor)

It signals the door status and the corresponding relay output status through the “**odc**” parameter: no = normal (any change); Fan = Fan OFF; CPr = Compressor OFF; F\_C = Compressor and fan OFF. Since the door is opened, after the delay time set through parameter “**d#d**”, the door alarm is enabled, the display shows the message “**dA**” and **the regulation restarts after rrd time.**

The alarm stops as soon as the external digital input is disabled again. With the door open, the high and low temperature alarms are disabled.

### 14.5 Start Defrost (DEF)

It executes a defrost if there are the right conditions. After the defrost is finished, the normal regulation will restart only if the digital input is disabled otherwise the instrument will wait until the “**Mdf**” safety time is expired.

### 14.6 Relay Aux Actuation (AUS)

This function allows to turn ON and OFF the auxiliary relay by using the digital input as external switch.

### 14.7 Relay Light Actuation (LIG)

This function allows to turn ON and OFF the light relay by using the digital input as external switch.

### 14.8 Remote ON/OFF (ONF)

This function allows to switch ON and OFF the instrument.

### 14.9 FHU – Not Used

This function allows to change the kind of regulation from cooling to heating and vice versa.

### 14.10 Energy Saving Input (ES)

The Energy Saving function allows to change the setpoint value as the result of the SET+ HES (parameter) sum. This function is enabled until the digital input is activated.

### 14.11 Map Switching (NT)

In this configuration, the digital input activates the map selected by the MP1 parameter. The “MAP CHANGE” MODBUS command has higher priority compared to the digital input.

## 14.12 Cleaning Function Activation (CLN)

In this configuration, the digital input activates the CLEANING function. It can be activated only if the device is ON.

This function has the following characteristics:

- The display visualizes the "CLn" label.
- The light status depends on the LCL parameter (No/Yes), however the light can be modified both via button and MODBUS command.
- The fans status depends on the FCL parameter (No/Yes), furthermore they are not thermo-regulated (par.FST).

The "CLEANING MODE" MODBUS command has higher priority compared to the digital input.

## 14.13 Defrost End (DEN)

The digital input ends the defrost cycle in progress. The drip time will follow the defrost end. A further defrost request with the digital input active will not be managed.

## 14.14 Digital Inputs Polarity

The digital inputs polarity depends on "I#P" parameters: CL: the digital input is activated by closing the contact; OP: the digital input is activated by opening the contact.


## 15 Use of the Programming Hot Key



XM controllers can download or upload the parameter list from its own non-volatile internal memory to the Hot Key and vice-versa through a TTL connector.

Figure 15-1 - Hot Key

### 15.1 Download (From the Hot Key to the Device)

1. Turn OFF the controller by pressing the on/off button  for five (5) seconds. **OFF** will display. Insert the Hot Key into the 5-pin connector labeled **HOT-KEY**, and then turn the controller back ON by pressing the on/off button again for five (5) seconds. The normal temperature value will display to indicate the controller is ON.
2. The parameter list of the Hot Key is downloaded into the controller memory automatically and **doL** will display. After 10 seconds, the controller will start working with the new parameters.
3. **End** will display at the end of the data transfer phase if the controller is programmed correctly. Err will display if there is an error or failure in programming.
  - **End** = correct programming. This means the controller will start regularly with the new programming.
  - **Err** = failed programming. In this case, turn the controller OFF and then ON if you want to restart the download again or remove the Hot Key to abort the operation.
4. Remove the Hot Key.

**NOTE:** The procedure may fail if the firmware version and the controller models are different.

### 15.2 Upload (From the Device to the Hot Key)

1. When the XM controller is ON, insert the Hot Key into the 5-pin connector labeled **HOT-KEY**.
2. Press and release the up arrow button.
3. The upload will begin, and **UPL** will blink on the display. **End** will display at the end of the data transfer phase if a successful upload has occurred. Err will display if there is an error or failure in programming.
  - **End** = correct programming.
  - **Err** = failed programming. In this case, press the **SET** key if you want to restart the programming again or remove the un-programmed Hot Key.
4. Remove the Hot Key.

**NOTE:** The upload procedure will overwrite everything previously uploaded from the last Hot Key upload.

## 16 Technical Data

Table 16-1- XM670K Technical Specifications

CX660 KEYBOARD	
Housing	Self-extinguishing PC+ABS
Dimensions	Case: CX660 fascia Front: 35 mm x 77 mm <b>Depth:</b> 18 mm
	<b>Panel Mount:</b> 29 mm x 71 mm panel cut-out
Protection	IP20 <b>Frontal:</b> IP65
Power Supply	From XM600K power module
Display	Three (3) digits, red LED, 14.2 mm high
Optional Output	Buzzer
POWER MODULES	
Case	8 DIN
Power Supply	Depending on the model 110Vac to 10% - 230Vac to 10% or 90 to 230Vac with switching power supply.
Overvoltage Category	III
Power Absorption	9VA max
Rated Impulse Voltage	2500V
Connections	Screw terminal block $\leq 1.6 \text{ mm}^2$ heat-resistant wiring and 5.0 mm Faston or screw terminals
Data Storing	On the volatile memory (EEPROM)
Kind of Action	1B
Pollution Degree	2
Ambient Operating Temperature	-10T60°C
Shipping and Storage Temperature	-40T85°C
Relative Humidity	20 to 85% (no condensing)
Resolution	1°C or 1°F or 0.1°C (selectable)
Measuring and Regulation Range	<b>NTC probe:</b> -58 to 230°F (-40 to 110°C)
	<b>PTC probe:</b> -67 to 302°F (-50 to 150°C)
	<b>Pt1000 probe:</b> -148 to 212°F (-100 to 100°C)
Accuracy (Ambient Temperature 25 °C)	$\pm 0,5^\circ\text{C} \pm 1 \text{ digit}$
Digital Inputs	Three (3) voltage-free
Inputs	Up to 4 NTC/PTC/Pt1000 probes
Serial Output	RS485 with MODBUS-RTU and LAN
Relay Outputs (Total current on loads MAX 16A)	<b>Solenoid Valve:</b> relay SPST 5(3) A, 250Vac
	<b>Defrost:</b> relay SPST 16A, 250Vac
	<b>Fan:</b> relay SPST 8A, 250Vac
	<b>Light:</b> relay SPST 16A, 250Vac
	<b>Alarm (XM670K):</b> SPDT relay 8A, 250Vac <b>Aux (XM670K):</b> SPST relay 8A, 250Vac
Optional Output (AnOUT) Depending on the model	<b>PWM/ Open Collector outputs:</b> PWM or 12VDC max 40mA
	<b>Analog Output:</b> 4 to 20mA or 0 to 10V
Purpose of Control	Operating Control
Construction of Control	Incorporated control, intended to be used in Class I or Class II equipment.

## 17 Default Setting Values

Table 17-1 - Default Setting Values

Label	M1	M2	M3	M4	Menu	Parameters Description
rtc		---			Pr1	Access by RTC submenu
SEC		LOC			---	LAN mode selection: Local or Global
SEt	2.0	2.0	-18.0	-18.0	---	Setpoint
Hy	2.0	2.0	2.0	2.0	Pr1	Differential
LS	-30	-30	-30	-30	Pr2	Minimum setpoint
US	10	10	10	10	Pr2	Maximum setpoint
odS		1			Pr2	Outputs activation delay at start up
AC		0			Pr2	Anti-short cycle delay
CCt		0.0			Pr2	Continuous cycle duration
CCS		2.0			Pr2	Continuous cycle setpoint
Con		5			Pr2	Compressor ON time with faulty probe
CoF		10			Pr2	Compressor OFF time with faulty probe
CF		°C			Pr2	Measurement unit: Celsius, Fahrenheit
rES		dE			Pr2	Resolution (only C): decimal, integer
Lod		P1			Pr2	Local display: default display
rEd		P1			Pr1	Remote display: default display
dLy		0			Pr1	Display delay
rPA		P1			Pr1	Regulation probe A
rPb		nP			Pr1	Regulation probe B
rP3		nP			Pr2	Regulation probe 3
rP4		nP			Pr2	Regulation probe 4
rPd		rPA			Pr2	Temperature Regulation Strategy
rPE		100			Pr2	Virtual probe percentage (rPd = rAb)
dPA		Pr2			Pr2	Defrost probe A
dPb		nP			Pr2	Defrost probe B
tdF	EL	EL	EL	EL	Pr2	Kind of defrost: air, resistors, inversion
EdF		in			Pr2	Defrost mode: Clock or interval

Table 17-1 - Default Setting Values

Label	M1	M2	M3	M4	Menu	Parameters Description
Srt	150				Pr2	Differential for heater
Hyr	2.0				Pr2	Time out for heater (if temp > Srt)
tod	255				Pr2	Defrost with two probes
d2P	n	n	n	n	Pr2	Defrost with two probes
dtE	8.0	8.0	8.0	8.0	Pr1	First defrost termination temperature
dtS	8.0	8.0	8.0	8.0	Pr2	Second defrost termination temperature
idF	6	6	6	6	Pr1	Interval between defrosts
idE	y				Pr2	Storage in EEPROM defrost interval
ndt	3	3	3	3	Pr2	Minimum Defrost Time
MdF	30	30	30	30	Pr2	Maximum defrost duration
dSd	0				Pr2	Delay for defrost on call
dFd	it				Pr2	Visualization during defrost
dAd	30				Pr2	Visualization delay for temperature after defrost
Fdt	0	0	2	2	Pr2	Dripping time
dPo	n				Pr2	Defrost at power ON
dAF	0				Pr2	Delay defrost after freezing
Pdt	F-C				Pr2	Pump down type
Pdn	0				Pr2	Pump down duration
Ctd	6	6	6	6	Pr2	Differential for defrost start
nbd	4.0	4.0	4.0	4.0	Pr2	Minimum Compressor run time before defrost
Mdb	16.0	16.0	16.0	16.0	Pr2	Maximum Compressor run time before defrost
nct	-30	-30	-30	-30	Pr2	Minimum coil temperature to trigger a defrost
FAP	P2				Pr2	Fan probe
FnC	O-y	o-y	o-n	o-n	Pr1	Fan operating mode
Fnd	0	0	5	5	Pr1	Fan delay after defrost
FCt	10				Pr2	Temperature differential to avoid short cycles of fans
FSt	15.0	15.0	2.0	2.0	Pr1	Fan stop temperature
FHy	1.0				Pr2	Fan stop hysteresis

Table 17-1 - Default Setting Values

Label	M1	M2	M3	M4	Menu	Parameters Description
tFE	n				Pr2	Fan regulation by temperature in defrost
Fod	0				Pr2	Fan activation time after defrost (without compressor)
Fon	0				Pr2	Fan ON time
FoF	0				Pr2	Fan OFF time
trA	UAL				Pr2	Kind of regulation with PWM output
SOA	0				Pr2	Fixed speed for fan
SdP	30.0				Pr2	Default Dewpoint value
ASr	1.0				Pr2	Differential for fan / offset for anti-sweat heater
PbA	5.0				Pr2	Proportional band for modulating output
AMi	0				Pr2	Minimum output for modulating output
AMA	100				Pr2	Maximum output for modulating output
AMt	3				Pr2	1:Time with fan at maximum speed 2:Time output ON anti sweat heater
rAL	tEr				Pr2	Probe for temperature alarm
ALC	Ab				Pr1	Temperature alarm configuration: relative / absolute
ALU	10	10	10	10	Pr1	High temperature alarm setting
ALL	-30	-30	-30	-30	Pr1	Low temperature alarm setting
AHy	1.0				Pr2	Differential for temperature alarm
ALd	15	15	15	15	Pr1	Temperature alarm delay
rA2	nP				Pr2	Probe for temperature alarm 2
A2U	150	150	150	150	Pr2	High temperature alarm 2 setting
A2L	-40	-40	-40	-40	Pr2	Low temperature alarm 2 setting
A2H	2				Pr2	Differential for temperature alarm 2
A2d	15	15	15	15	Pr2	Temperature alarm delay 2
dAO	1.0	1.0	1.0	1.0	Pr2	Delay of temperature alarm at start-up
EdA	60				Pr2	Alarm delay at the end of defrost
dot	30				Pr2	Temperature alarm exclusion after door open
tbA	n				Pr2	Silencing alarm relay with buzzer

Table 17-1 - Default Setting Values

Label	M1	M2	M3	M4	Menu	Parameters Description
oA5*		ALr			Pr2	Relay 5 configuration
oA6*		AUS			Pr2	Relay 6 configuration
CoM		420			Pr2	Modulating output configuration
AOP		CL			Pr2	Alarm relay polarity
iAU		n			Pr2	Auxiliary output independent from ON/OFF state
i1P		CL			Pr2	Digital input 1 polarity
i1F		dor			Pr1	Digital input 1 configuration
d1d		15			Pr1	Digital input 1 activation delay
i2P		CL			Pr2	Digital input 2 polarity
i2F		LiG			Pr1	Digital input 2 configuration
d2d		5			Pr1	Digital input 2 activation delay
i3P		CL			Pr2	Digital input 3 polarity
i3F		ES			Pr1	Digital input 3 configuration
d3d		0			Pr1	Digital input 3 activation delay
nPS		15			Pr1	Pressure switch number
OdC		F-C			Pr2	Compressor and fan status when open door
rrd		30			Pr2	Outputs restart after door open alarm
CbP		y			Pr2	Clock presence
Hur		---			Pr1	Current hour
Min		---			Pr1	Current minutes
dAY		---			Pr1	Current day
Hd1		nu			Pr1	First weekly day
Hd2		nu			Pr1	Second weekly day
Hd3		nu			Pr1	Third weekly day
ILE		0.0			Pr1	Energy saving cycle start during workdays
dLE		0.0			Pr1	Energy saving cycle length during workdays
ISE		0.0			Pr1	Energy saving cycle start during holidays
dSE		0.0			Pr1	Energy saving cycle length during holidays

**Table 17-1 - Default Setting Values**

Label	M1	M2	M3	M4	Menu	Parameters Description
Ld1		6.0			Pr1	Workdays First defrost start
Ld2		13.0			Pr1	Workdays Second defrost start (minimum as Ld1)
Ld3		21.0			Pr1	Workdays Third defrost start (minimum as Ld2)
Ld4		nu			Pr1	Workdays Fourth defrost start (minimum as Ld3)
Ld5		nu			Pr1	Workdays Fifth defrost start (minimum as Ld4)
Ld6		nu			Pr1	Workdays Sixth defrost start (minimum as Ld5)
Sd1		6.0			Pr1	Holidays First defrost start
Sd2		13.0			Pr1	Holidays Second defrost start
Sd3		21.0			Pr1	Holidays Third defrost start
Sd4		nu			Pr1	Holidays Fourth defrost start
Sd5		nu			Pr1	Holidays Fifth defrost start
Sd6		nu			Pr1	Holidays Sixth defrost start
HES		0.0			Pr1	Temperature increasing during Energy Saving
PEL		n			Pr1	Energy saving activation when Light switched off
LMd		y			Pr2	Defrost Synchronization
dEM		y			Pr2	Defrost end Synchronization
LSP		n			Pr2	Setpoint Synchronization
LdS		n			Pr2	Display Synchronization (temperature sent via LAN)
LOF		n			Pr2	ON/OFF Synchronization
LLi		y			Pr2	Light Synchronization
LAU		n			Pr2	AUX Synchronization
LES		n			Pr2	Energy Saving Synchronization
LSd		n			Pr2	Remote probe displaying
LCP		n			Pr2	P4 probe sent via LAN
StM		n			Pr2	Cooling request from LAN enable compressor relay
ACE		n			Pr2	Cold Calling in LAN always enabled even if the compressor block
P1C		ntc			Pr2	P1 configuration
OF1		0.0			Pr2	P1 calibration

Table 17-1 - Default Setting Values

Label	M1	M2	M3	M4	Menu	Parameters Description
P2C		ntc			Pr2	P2 configuration
OF2		0.0			Pr2	P2 calibration
P3C		nu			Pr2	P3 configuration
OF3		0.0			Pr2	P3 calibration
P4C		nu			Pr2	P4 configuration
OF4		0.0			Pr2	P4 calibration
LCL		y			Pr2	Light on during cleaning mode
FCL		y			Pr2	Fan on during cleaning mode
MAP		1°M			Pr2	Map selection
MP1		1°M			Pr2	Map selection loaded by digital input
Adr		1			Pr1	MODBUS address
br		96			Pr2	Baud Rate selection for MODBUS: 9600 or 19200
EMU		nu			Pr2	Emulation previous version: 2V8, 3V8, 4V2
rEL		5.4			Pr2	Release code firmware (only read)
SrL		-			Pr2	Sub-release firmware (only read)
Ptb		-			Pr2	Map EEPROM ID
Pr2		321			Pr1	Password

Visit our website at [copeland.com/en-us/products/controls-monitoring-systems](https://copeland.com/en-us/products/controls-monitoring-systems) for the latest technical documentation and updates.

For Technical Support call **833-409-7505** or email **ColdChain.TechnicalServices@Copeland.com**